

X 7066200


X 7066150

X 7066100






Y 480400

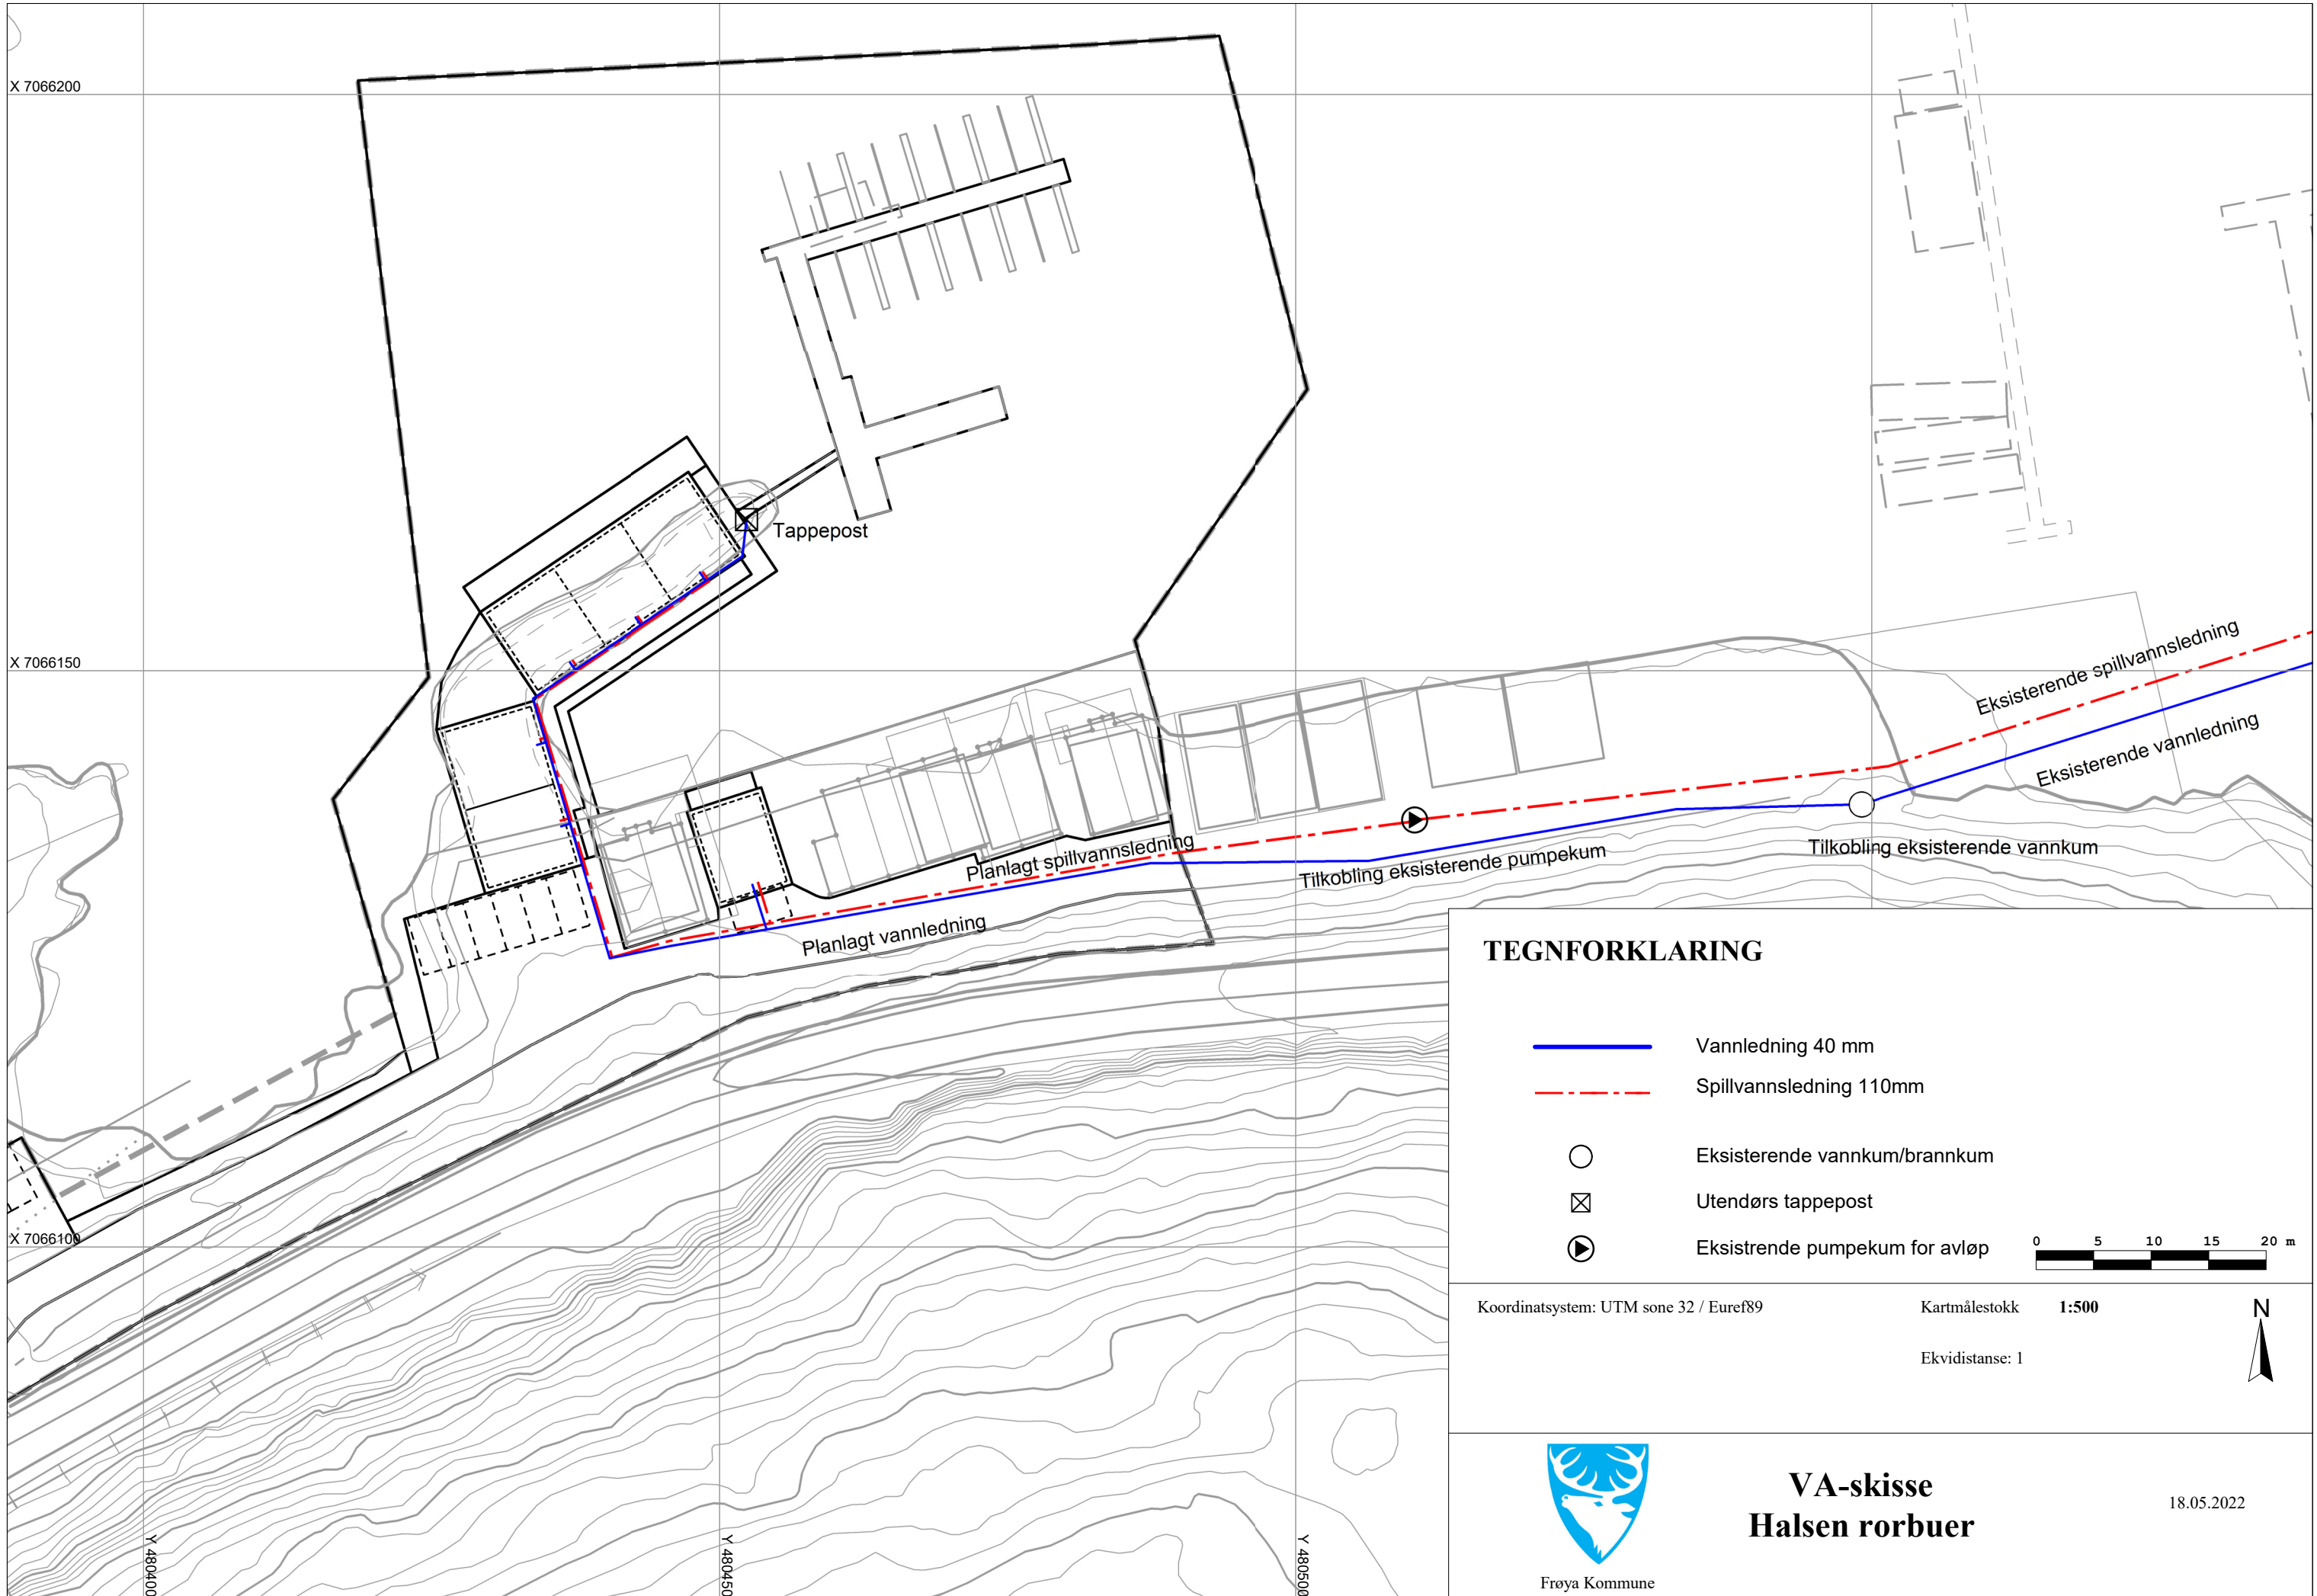
Y 480450

Y 480500



TEGNFORKLARING

-  Vannledning 40 mm
-  Spillvannsledning 110mm
-  Eksisterende vannkum/brannkum
-  Utendørs tappepost
-  Eksisterende pumpekum for avløp



Koordinatsystem: UTM sone 32 / Euref89

Kartmålestokk **1:500**

Ekvidistanse: 1

N



Frøya Kommune

VA-skisse Halsen rorbuer

18.05.2022